



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

Weather Shield Manufacturing, Inc.
One Weather Shield Plaza (P.O. Box 309)
Medford, WI 54451-0309

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "Contempra TFT Direct Set" Aluminum Clad Wood Fixed Window - L.M.I.

APPROVAL DOCUMENT: Drawing No. 1054, titled "Direct Set 'Contempra' TFT Aluminum Clad Wood Window", sheets 1 through 4 of 4, dated 06/07/01, with revision C1 dated 06/25/14, prepared by W. W. Schaefer Engineering & Consulting, P.A., signed and sealed by Warren W. Schaefer, P.E., bearing the Miami-Dade County Product Control Section Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA# 13-0205.12 and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by Manuel Perez, P.E.



Handwritten signature and date:
7/6/26/14

NOA No. 14-0424.17
Expiration Date: April 15, 2018
Approval Date: July 03, 2014
Page 1

Weather Shield Manufacturing, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **1054**, titled "Direct Set 'Contempra' TFT Aluminum Clad Wood Window", sheets 1 through 4 of 4, dated 06/07/01, with revision C1 dated 06/25/14, prepared by W. W. Schaefer Engineering & Consulting, P.A., signed and sealed by Warren W. Schaefer, P.E.

B. TESTS

1. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of aluminum clad wood fixed casement window, prepared by Stork Twin City Testing Corporation, Test Report No. **TCTCWI-04014**, dated 12/07/04, signed and sealed by Thomas Allan Kolden, P.E.
(Submitted under NOA No. 05-0420.05)
2. Test reports on: 1) Large Missile Impact Test per FBC, TAS 201-94
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of an aluminum clad wood fixed casement window, prepared by Hurricane Test Laboratory, LLC, Test Report No. **HTL 0037-0304-00**, dated 02/28/00, signed and sealed by Vinu J. Abraham, P.E.
(Submitted under NOA No. 03-0123.01)
3. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of an aluminum clad wood fixed casement window, prepared by Hurricane Test Laboratory, LLC, Test Reports No. **HTL 0037-0208-98** and **HTL 0037-1105-00**, dated 02/11/98 and 11/06/00, all signed and sealed by Vinu J. Abraham, P.E.
(Submitted under NOA No. 01-0831.03)
4. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of a direct set wood fixed window, prepared by Architectural Testing, Inc., Test Report No. **ATI-16360**, dated 09/11/95, signed and sealed by Allen N. Reeves, P.E.
(Submitted under NOA No. 98-1110.10)


Manuel Perez, P.E.
Product Control Examiner
NOA No. **14-0424.17**

Expiration Date: April 15, 2018
Approval Date: July 03, 2014

Weather Shield Manufacturing, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with **FBC-2010**, dated 06/06/01 and revised on 01/30/13, prepared by W. W. Schaefer Engineering & Consulting, P.A., signed and sealed by Warren W. Schaefer, P.E.
(Submitted under previous NOA #13-0206.12)
2. Glazing complies with **ASTM E1300-04**

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **13-0909.10** issued to **Glasslam N.G.I., Inc.** for their "Glasslam Safety-Plus II Glass Interlayer" dated 10/03/13, expiring on 08/07/18.
2. Notice of Acceptance No. **12-1231.10** issued to **Eastman Chemical Company (MA)** for their "Saflex Clear and Color Glass Interlayers" dated 03/28/13, expiring on 05/21/16.

F. STATEMENTS



1. Statement letter of conformance, complying with **FBC-2010** and **FBC 5th Edition (2014)**, dated April 10, 2014, signed and sealed by Warren W. Schaefer, P.E.
2. Statement letter of no financial interest, dated September 17, 2012, signed and sealed by Warren W. Schaefer, P.E.
(Submitted under previous NOA #12-0919.06)
3. Laboratory compliance letters for Test Report No. **TCTC-180-6892**, issued by Stork Twin City Testing Corporation, dated 12/07/04, signed and sealed by Thomas Allan Kolden, P.E.
(Submitted under NOA No. 05-0420.03)
4. Laboratory compliance letters for Test Reports No. **HTL 0037-0205-01** and **HTL 0037-0106-02**, issued by Hurricane Test Laboratory, LLC, dated 01/08/01 and 02/07/01, signed and sealed by Vinu J. Abraham, P.E.
(Submitted under NOA No. 02-1018.09)

G. OTHERS

1. Notice of Acceptance No. **14-0424.13**, issued to Weather Shield Manufacturing, Inc. for their Series "Legacy" Direct Set Aluminum Clad Wood Fixed Window – L.M.I., approved on 12/27/12 and expiring on 02/13/18.


Manuel Perez, P.E.
Product Control Examiner
NOA No. 14-0424.17

Expiration Date: April 15, 2018
Approval Date: July 03, 2014

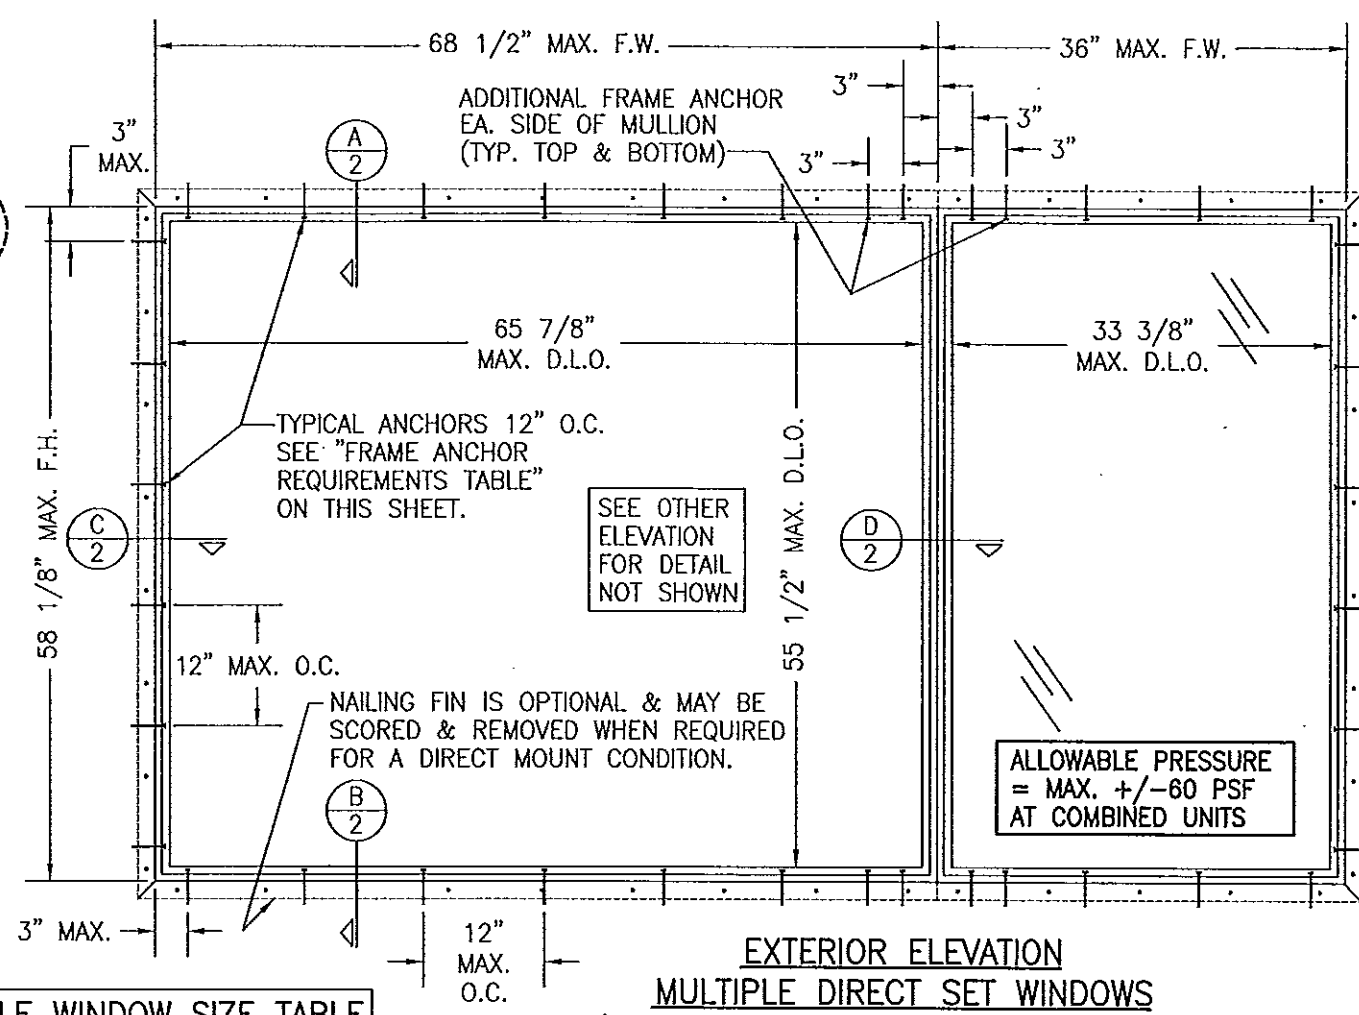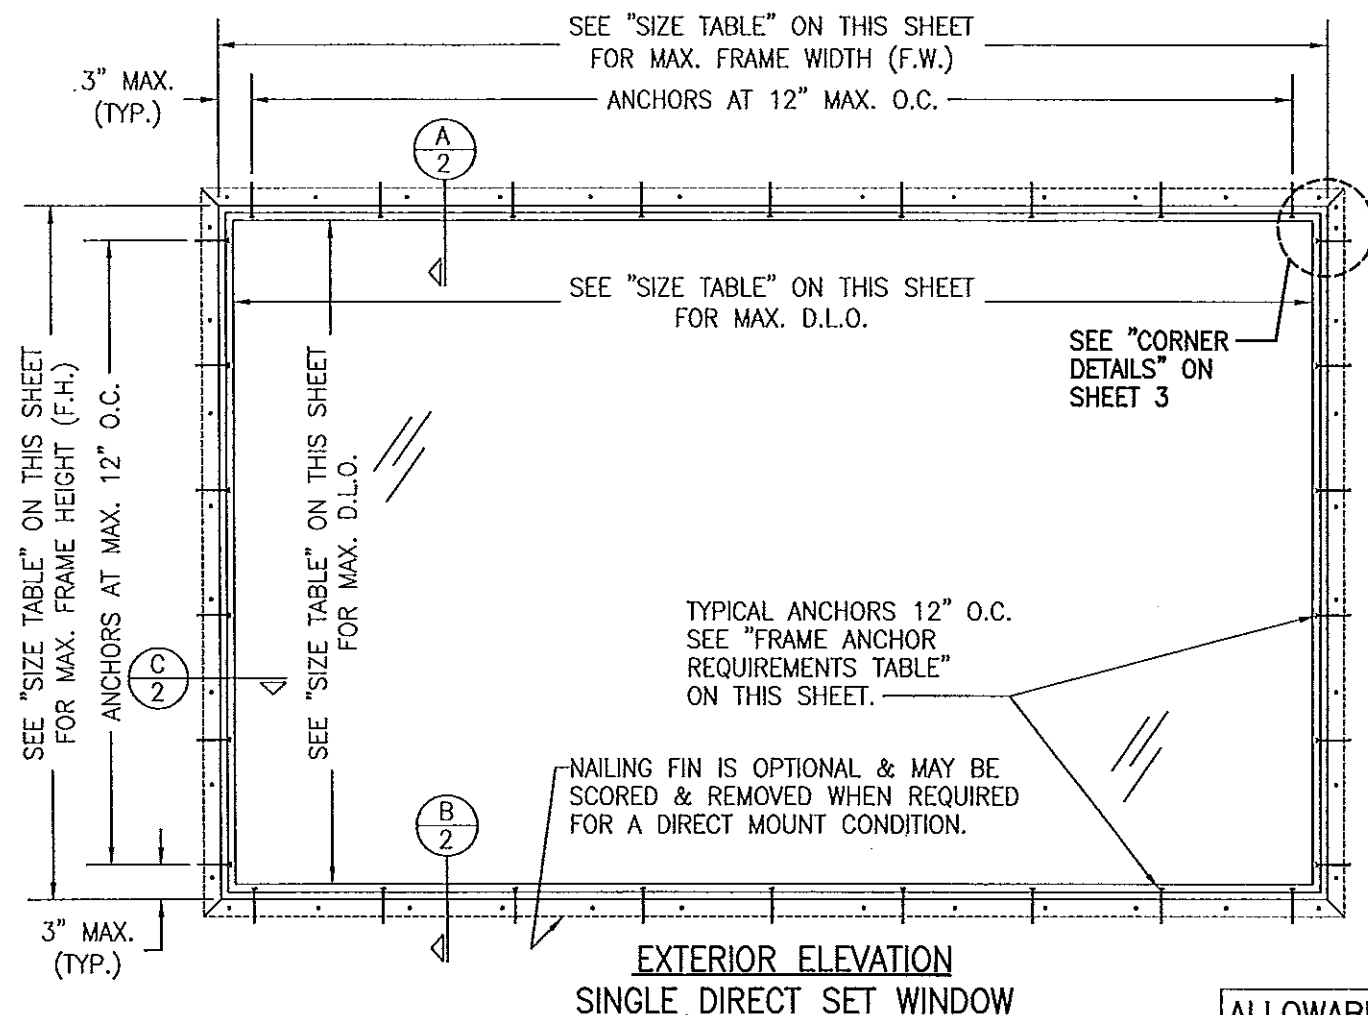

APPROVED SHAPES		
RECTANGULAR	OCTAGON	PARALLELOGRAM
FULL CIRCLE	CATHEDRAL/GOTHIC	INVERTED CIRCLE TOP
HALF CIRCLE	EXTENDED ELLIPTICAL	INVERTED ARCH TOP
QUARTER CIRCLE	MITERED CORNER	EXTENDED HALF ROUND
CIRCLE TOP	ARCH TOP	EXTENDED SEGMENTAL
HALF CIRCLE TOP	TRIANGULAR	QUARTERFOIL
OVAL	TRAPEZOID	PARTIAL ARCH
ELLIPTICAL	PENTAGON	EYEBROW
PARTIAL ELLIPTICAL		

NOTE: ALL SHAPED UNITS MUST FIT INSCRIBED INTO THE ALLOWABLE RECTANGULAR UNITS & BE GOVERNED BY THE ALLOWABLE PRESSURE OF FOR THE RESPECTIVE RECTANGULAR UNIT

GENERAL NOTES:

- THESE WINDOW SYSTEMS HAVE BEEN TESTED, ANALYZED & APPROVED FOR DESIGN PRESSURES NOT TO EXCEED THOSE SHOWN IN THE "ALLOWABLE DESIGN PRESSURE TABLE(S)".
- OPENINGS, BUCKING & BUCKING FASTENERS MUST BE PROPERLY DESIGNED & INSTALLED TO TRANSFER WIND LOADS TO THE STRUCTURE.
- ALL HARDWARE & FASTENERS SHALL BE IN ACCORDANCE WITH THESE DRAWINGS & SHALL NOT VARY UNLESS SPECIFICALLY MENTIONED ON THE DRAWINGS. SPECIFIED ANCHOR EMBED TO BASE MATERIAL SHALL BE BEYOND WALL FINISH OR STUCCO.
- THE DETAILS & SPECIFICATIONS SHOWN HEREIN REPRESENT THE PRODUCTS TESTED & PROPOSED FOR WATER, AIR, IMPACT, CYCLIC & UNIFORM STATIC AIR PRESSURE TESTING IN CONFORMANCE WITH THE FLORIDA BUILDING CODE PROTOCOLS TAS-201, 202 & 203 FOR LARGE MISSILE IMPACT WINDOWS.
- THESE WINDOW SYSTEMS HAVE BEEN DESIGNED IN ACCORDANCE WITH AND MEET THE REQUIREMENTS OF THE FLORIDA BUILDING CODE (FBC) INCLUDING HIGH VELOCITY HURRICANE ZONES (HVHZ).
- IMPACT SHUTTERS ARE NOT REQUIRED WITH THESE WINDOWS.
- ALL ANCHORS SECURING WINDOW FRAME TO PRESSURE TREATED BUCKS OR WOOD FRAMING SHALL BE CAPABLE OF RESISTING CORROSION CAUSED BY THE PRESSURE TREATING CHEMICALS IN THE WOOD.
- DETERMINE THE POSITIVE & NEGATIVE DESIGN LOADS TO USE WHEN REFERENCING THESE DOCUMENTS IN ACCORDANCE WITH THE GOVERNING CODE AND GOVERNING WIND VELOCITY. FOR WIND LOAD CALCULATIONS IN ACCORDANCE WITH THE FLORIDA BUILDING CODE, A DIRECTIONALITY FACTOR OF $K_d = 0.85$ MAY BE APPLIED PER THE ASCE-7 STANDARD.
- NO INCREASE IN ALLOWABLE STRESS HAS BEEN USED IN THE CERTIFICATION OF THIS PRODUCT. WIND LOAD DURATION FACTOR $C_d = 1.6$ WAS USED FOR WOOD SCREW ANALYSIS ONLY.
- MATERIALS, INCLUDING BUT NOT LIMITED TO STEEL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF FLORIDA BUILDING CODE CHAPTER 20.
- ALL WOOD MEMBERS OF WINDOWS THAT MAY POSSIBLY COME INTO CONTACT WITH MASONRY OR CONCRETE SUBSTRATES, ARE SUBJECT TO MOISTURE &/OR ARE SUBJECT TO THE OUTSIDE ENVIRONMENT SHALL BE OF AN APPROVED DURABLE SPECIES OR BE TREATED IN AN APPROVED METHOD WITH AN APPROVED PRESERVATIVE PER FBC SECTION 2326.

ALLOWABLE WINDOW SIZE TABLE

HEIGHT (IN.)	WIDTH (IN.)	D.L.O. (IN.)	
		HEIGHT	WIDTH
47	124	44 3/8	121 3/8
48	120	45 3/8	117 3/8
54	108	51 3/8	105 3/8
58	100	55 3/8	97 3/8
59 3/4	97 1/2	57 1/8	94 7/8
72	80	69 3/8	77 3/8

APPLICABLE FOR SINGLE WINDOWS ONLY.

NOTES:

- HEIGHT (F.H.) & WIDTH (F.W.) ARE INTERCHANGABLE.
- ALL HEIGHT & WIDTH DIMENSIONS ARE $\pm 1/2"$

FRAME ANCHOR REQUIREMENTS TABLE			
OPENING TYPE (SUBSTRATE)	JAMB TO OPENING FASTENER TYPE	MINIMUM EMBEDMENT	MINIMUM EDGE DIST.
MIN. 2X4 WOOD FRAME OR BUCK (MIN. GR. 3 & $G=0.55$)	NO. 10 SMS SCREW	1 3/8"	1"
MIN. C-90 CMU OR 2500 PSI CONCRETE	3/16" CONCR. SCREW	1 1/4"	2"

CONCRETE SCREWS SHALL BE ELCO ULTRACONS, ITW RAMSET/RED HEAD TAPCONS, HILTI KWIK-CON II OR POWERS RAWL TAPPER (HARDENED STEEL OR S.S.).

MULTIPLE UNIT NOTES:

- WHEN BOTH WINDOWS ARE TO BE WIDER THAN 36" (F.W.), BOTH WINDOWS SHALL BE RESTRICTED BY A MAXIMUM F.W. OF 48".
- WHEN EITHER WINDOW IS TO BE 36" F.W. OR LESS, THE OTHER WINDOW MAY BE UP TO 68 1/2" F.W.
- THE MAXIMUM ALLOWABLE PRESSURE FOR A COMBINED UNIT IS RESTRICTED BY THE LESSER OF THE INDIVIDUAL WINDOW ALLOWABLE PRESSURE OR ± 60 PSF UNLESS A CLIPPED MULLION IS USED PER WEATHER SHIELD'S MULLION APPROVAL.
- FOR CLIPPED MULLION COMBINATIONS, SEE DRAWINGS NO. M96-05 & M96-06 UNDER SEPERATE APPROVAL.

FOR ALLOWABLE DESIGN WIND PRESSURE ON SINGLE WINDOWS, SEE LOAD TABLES ON SHEET 4.

IMPACT RESISTANT WINDOWS
SHUTTERS NOT REQUIRED

PRODUCT REVISED

as complying with the Florida

Building Code

Acceptance No. 14-0424.17

Expiration Date April 15, 2018

By *Manuel Perez*

Miami Dade Product Control

THESE DRAWINGS ARE APPLICABLE ONLY TO THE PRODUCT SPECIFIED. THEY MAY NOT BE USED FOR THE ASSEMBLY AND/OR INSTALLATION OF ANY OTHER PRODUCT NOR MAY THEY BE USED FOR RATIONAL AND/OR LOCAL APPROVAL OF ANY PRODUCT NOT PRODUCED BY THE MANUFACTURER STATED ON THESE DRAWINGS.

DRAWN BY: W.W.S.		CHECKED BY: W.W.S.	
PLOT: 1=16		DATE: 06/07/01	
NO.	REVISION DESCRIPTION	DATE	BY
A1	ADDED NEW GLASS & GLAZING		
A2	UPDATE LOAD TABLES TO ASTM E1300-02		
A3	UPDATE GENERAL NOTES	11/02/11	
B1	UPDATE TO CURRENT STANDARDS	06/25/14	
C1	UPDATE GLAZING DETAILS		






DRAWING TITLE: DIRECT SET 'CONTEMPRA' TFT ALUMINUM CLAD WOOD WINDOW

MANUFACTURER: WEATHER SHIELD WINDOWS & DOORS
ONE WEATHER SHIELD PLAZA
MEDFORD, WI 54451
715-748-6555

CONSULTANTS: W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. (CA 6809)
7480 150TH COURT NORTH
PALM BEACH GARDENS, FL 33418
PHONE: 561-744-3424

CERTIFICATION: JUN 25 2014
WARREN W. SCHAEFER, P.E.
P.E. NO. 44135

DRAWING NO. 1054
SHEET NO. 1 OF 4

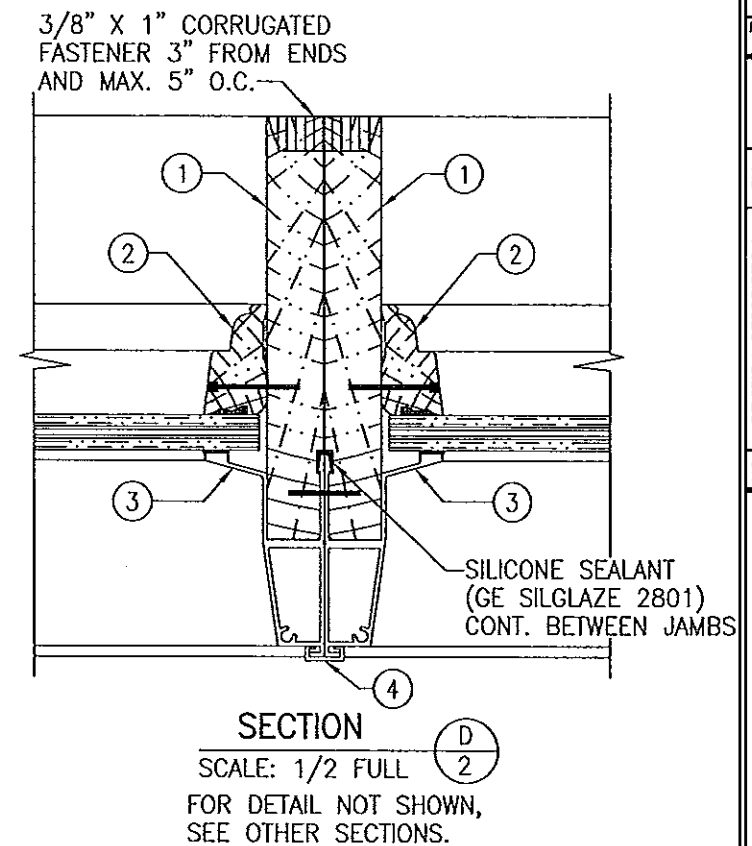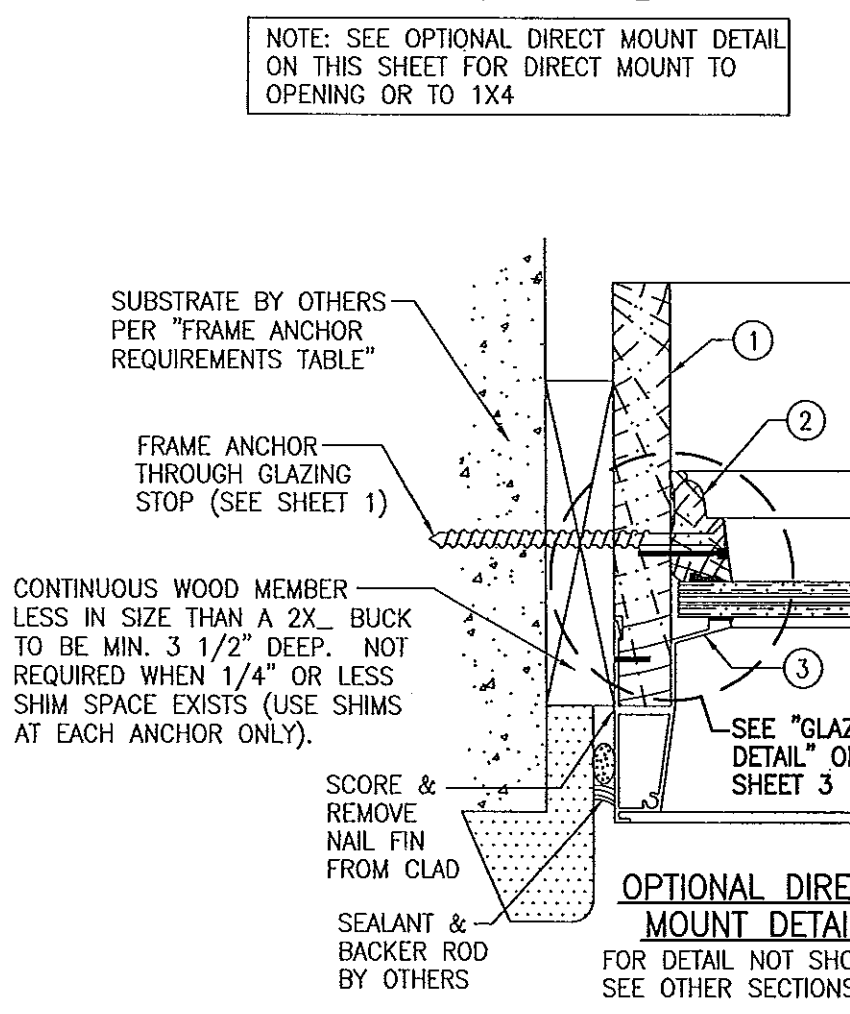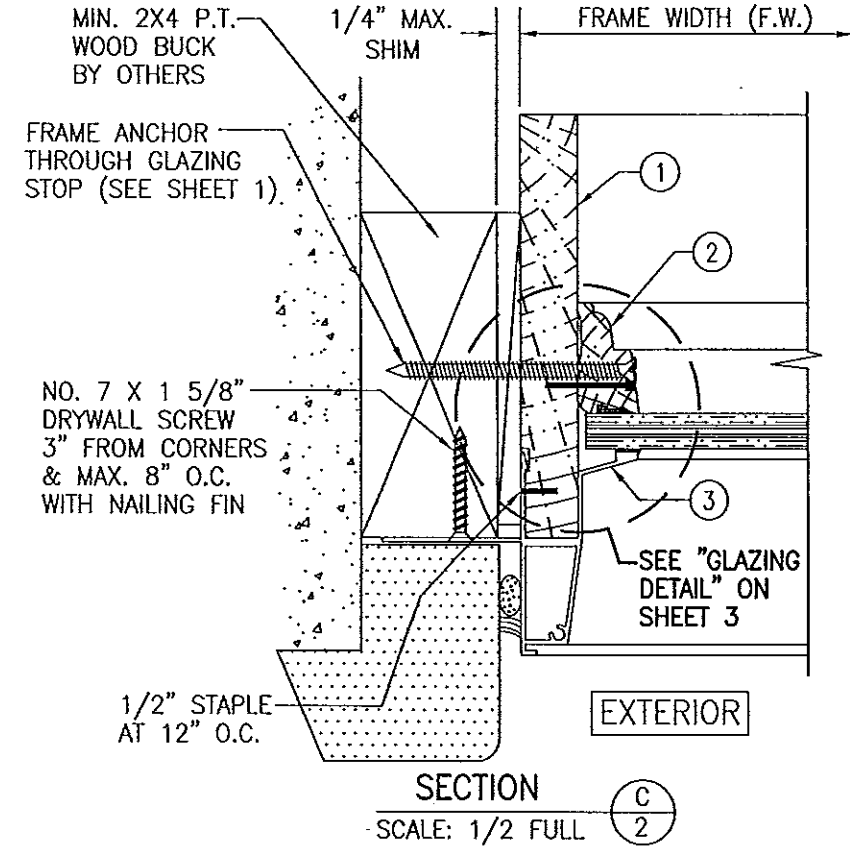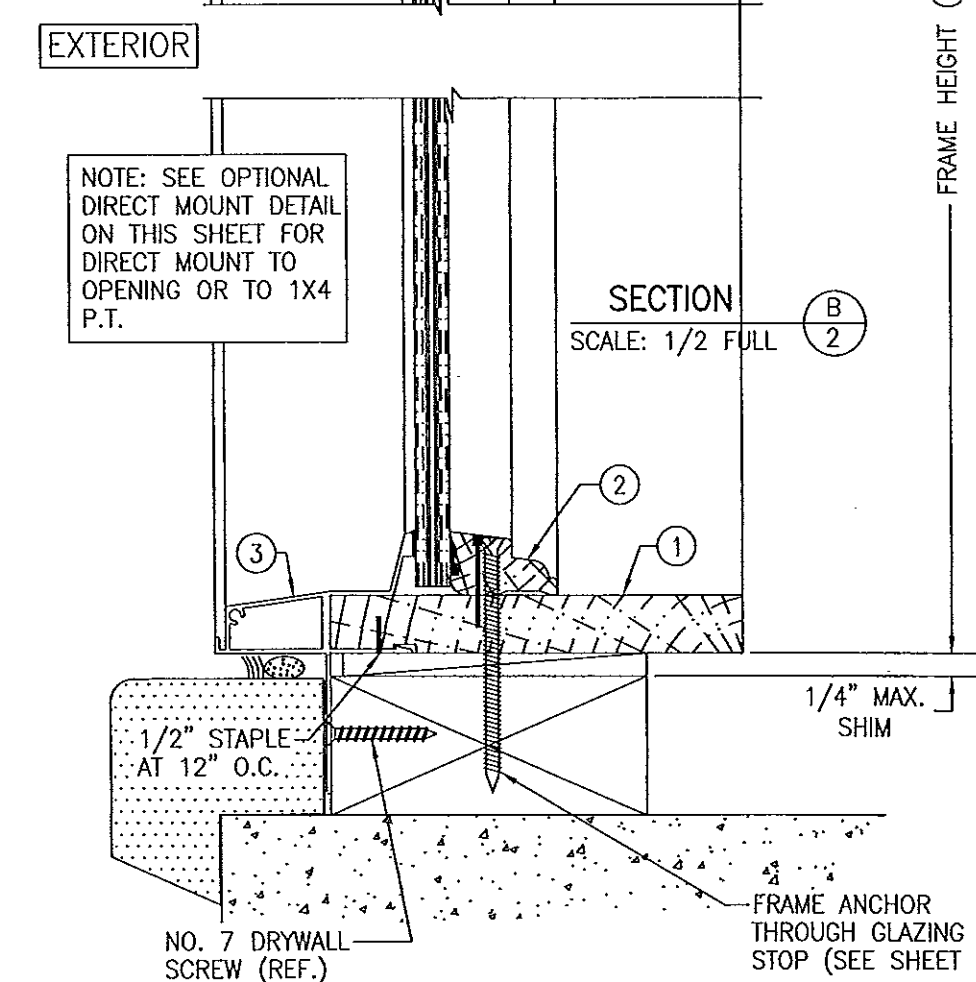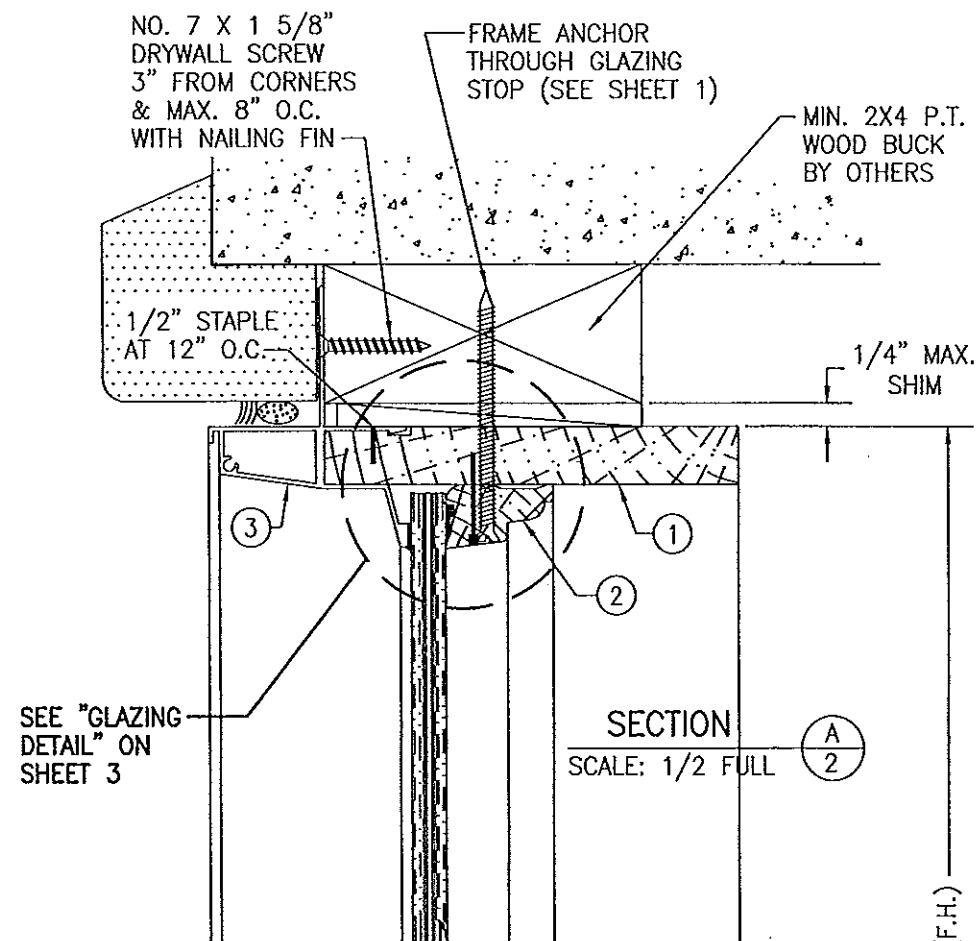

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 14-0424-17
Expiration Date April 15, 2018
By *Manuel Perez*
Miami Dade Product Control




DRAWN BY: W.W.S.		CHECKED BY: W.W.S.	
PLOT: 1=2		DATE: 08/07/01	
NO.	REVISION DESCRIPTION	BY	DATE
DRAWING TITLE DIRECT SET 'CONTEMPRA' TFT ALUMINUM CLAD WOOD WINDOW			
CONSULTANTS W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. (CA 6809) 7480 150TH COURT NORTH PALM BEACH GARDENS, FL 33418 PHONE: 561-744-3424		MANUFACTURER WEATHER SHIELD WINDOWS & DOORS ONE WEATHER SHIELD PLAZA MEDFORD, WI 54451 715-748-6555	
CERTIFICATION JUN 25 2014 WARREN W. SCHAEFER, P.E. P.E. NO. 44135			
DRAWING NO. 1054		REV. C	
SHEET NO. 2 OF 4			



ITEM #	PART #	REQD.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	902922	4	HEAD, SILL & SIDE JAMB	* WOOD	WEATHER SHIELD
2	902902	4	GLAZING BEAD	* WOOD	WEATHER SHIELD
3	902920	4	JAMB CLAD (TFT)	6063-T5 ALUMINUM	WEATHER SHIELD
4	780959	1	TFT MULLION CAP	6063-T5 ALUMINUM	CAPITAL PRODUCTS

* WOOD USED IN TESTING WAS WESTERN PINE. OTHER WOOD SPECIES APPLICABLE FOR USE WITH THIS PRODUCT ARE THOSE WITH A SPECIFIC GRAVITY OF 0.43 AND MODULUS OF ELASTICITY OF 1,200,000 PSI OR GREATER. ALL WOOD IS MINIMUM GRADE 2 MILLED BY WEATHER SHIELD TO SELECT.

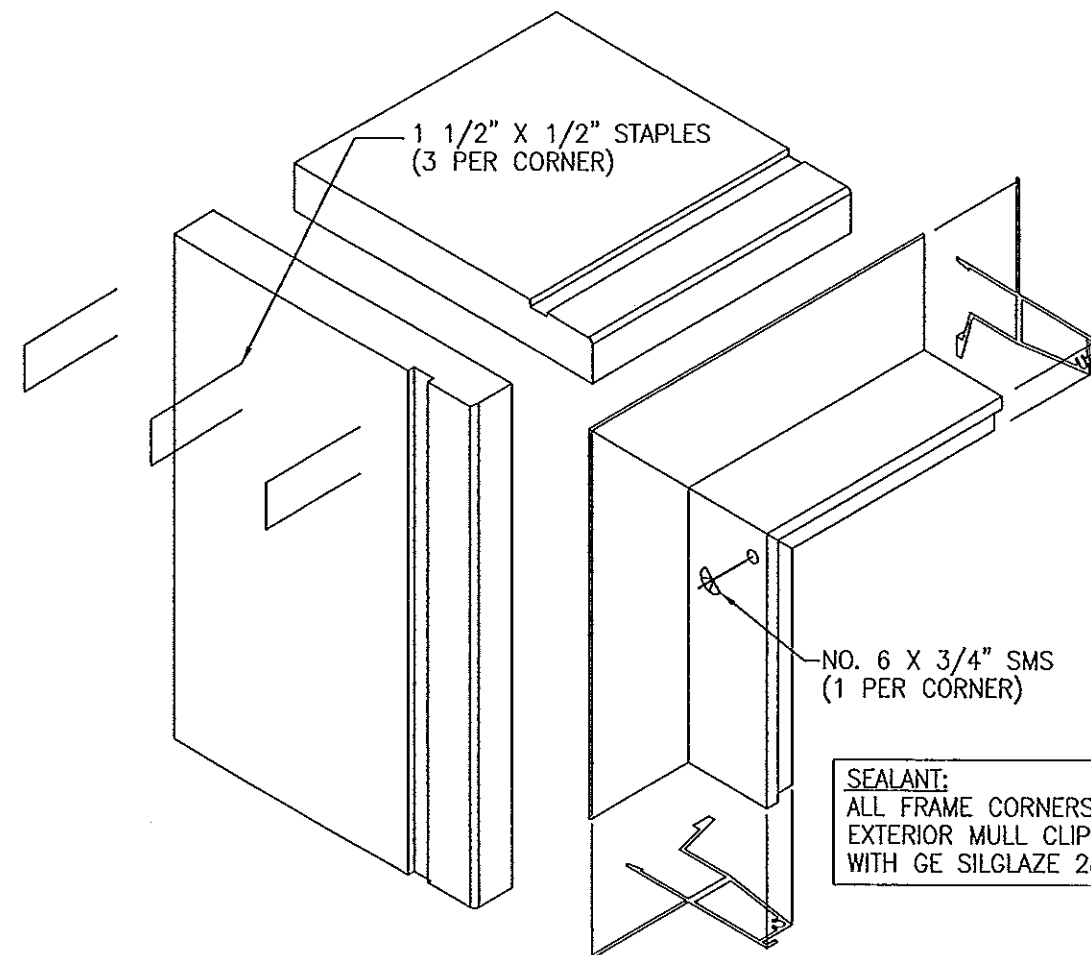

SEALANT:
ALL FRAME CORNERS, JOINTS &
EXTERIOR MULLION CLIP SEALED
WITH GE SILGLAZE 2801

GLAZING OPTION 3:
7/16" THK. LAMINATED GLASS
(3/16" AN/0.09 EASTMAN
CHEMICAL CO. SAFLEX/3/16" AN)


FRAME CORNER DETAIL

SIKA FLEX 552
SILICONE SEALANT
(3 SIDES OF GLAZING
GLAZING POCKET)

1/2" MIN.
GLASS BITE

GLAZING DETAIL 3


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 14-0424-17
Expiration Date 06/15/2018
By *Manuel Lopez*
Miami Dade Product Control

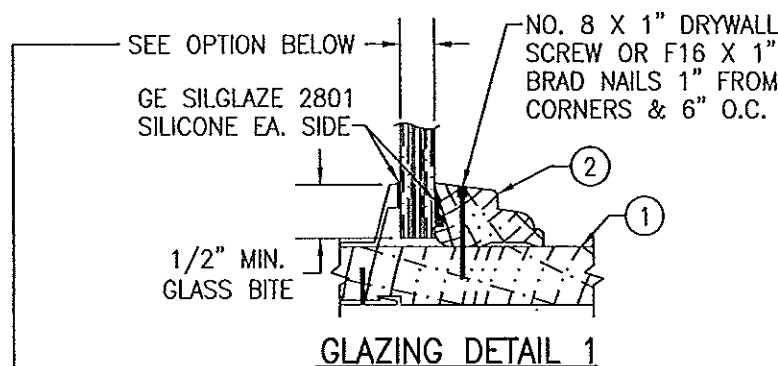

GLAZING DETAIL 1

GLAZING OPTIONS (TYP. FOR DETAIL 1):

GLAZING OPTION 1) 1/2" THK. GLASSLAM SAFETY PLUS II LAMINATED GLASS (3/16" AN/0.06 RESIN/
0.01 PET/0.06 RESIN/3/16" AN)

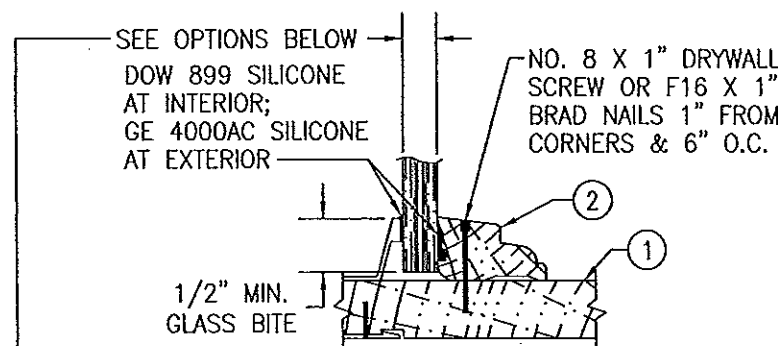

GLAZING DETAIL 2

GLAZING OPTIONS (TYP. FOR DETAIL 2):

GLAZING OPTION 2) 9/16" THK. LAMINATED GLASS
(1/4" H.S./0.09 EASTMAN CHEMICAL CO. SAFLEX/1/4" H.S.)

DRAWN BY: W.W.S.		CHECKED BY: W.W.S.	
PLOT: 1=2		DATE: 06/07/01	
NO.	DATE	BY	REVISION DESCRIPTION
DRAWING TITLE DIRECT SET 'CONTEMPRA' TFT ALUMINUM CLAD WOOD WINDOW			
CONSULTANTS W. W. SCHAEFFER ENGINEERING & CONSULTING, P.A. (CA 6809)		MANUFACTURER WEATHER SHIELD WINDOWS & DOORS ONE WEATHER SHIELD PLAZA MEDFORD, WI 54451 715-748-6555	
7480 150TH COURT NORTH PALM BEACH GARDENS, FL 33418 PHONE: 561-744-3424		P.E. NO. 44133	
CERTIFICATION JUN 25 2014		DRAWING NO. 1054	
SHEET NO. 3 OF 4		REV. C	

9/16" SOLUTIA SAFLEX IIIG LAMINATED HEAT STRENGTHENED GLASS (WITH GLAZING DETAIL 2 & GLAZING OPTION 2)																	
(1) SHORT DIMENSION	DESIGN LOAD CAPACITY (PSF)																
	POS.	NEG.	POS.	NEG.	POS.	NEG.	POS.	NEG.	POS.	NEG.	POS.	NEG.	POS.	NEG.	POS.	NEG.	POS.
30"	55.0	67.0	55.0	67.0	55.0	67.0	55.0	67.0	55.0	67.0	55.0	67.0	55.0	67.0	55.0	67.0	55.0
36"	55.0	67.0	55.0	67.0	55.0	67.0	55.0	67.0	55.0	67.0	55.0	67.0	55.0	67.0	55.0	67.0	55.0
42"	55.0	67.0	55.0	67.0	55.0	67.0	55.0	67.0	55.0	67.0	55.0	67.0	55.0	67.0	55.0	67.0	55.0
48"	55.0	67.0	55.0	67.0	55.0	67.0	55.0	67.0	55.0	67.0	55.0	67.0	55.0	67.0	55.0	67.0	55.0
54"	55.0	67.0	55.0	67.0	55.0	67.0	55.0	67.0	55.0	67.0	55.0	67.0	55.0	67.0	55.0	67.0	55.0
60"	55.0	67.0	55.0	67.0	55.0	67.0	55.0	67.0	55.0	67.0	55.0	67.0	55.0	67.0	55.0	67.0	55.0
66"	50.0	60.9	50.0	60.9	50.0	60.9											
72"	45.8	55.8	45.8	55.8													
(1) LONG DIMENSION	72"	80"	88"	96"	98"	104"	108"	120"									

7/16" SOLUTIA SAFLEX IIIG LAMINATED ANNEALED GLASS (WITH GLAZING DETAIL 3 & GLAZING OPTION 3)																									
(1) SHORT DIMENSION	DESIGN LOAD CAPACITY (PSF)																								
	POS.	NEG.	POS.	NEG.	POS.	NEG.	POS.	NEG.	POS.	NEG.	POS.	NEG.	POS.	NEG.	POS.	NEG.	POS.	NEG.	POS.	NEG.	POS.	NEG.	POS.	NEG.	POS.
24"	60.0	75.0	60.0	75.0	60.0	75.0	60.0	75.0	60.0	75.0	60.0	75.0	60.0	75.0	60.0	75.0	60.0	75.0	60.0	75.0	60.0	75.0	60.0	75.0	60.0
30"	60.0	75.0	60.0	75.0	60.0	75.0	60.0	75.0	60.0	75.0	60.0	75.0	60.0	75.0	60.0	75.0	60.0	75.0	60.0	75.0	60.0	75.0	60.0	75.0	60.0
36"	60.0	75.0	60.0	75.0	60.0	75.0	60.0	75.0	60.0	75.0	60.0	75.0	60.0	75.0	60.0	75.0	60.0	75.0	60.0	75.0	60.0	75.0	60.0	75.0	60.0
42"	60.0	75.0	60.0	75.0	60.0	75.0	60.0	75.0	60.0	75.0	60.0	75.0	60.0	75.0											
48"	60.0	75.0	60.0	75.0	60.0	75.0	60.0	75.0	60.0	75.0	60.0	75.0	60.0	70.1											
54"	60.0	75.0	60.0	75.0	60.0	75.0	60.0	75.0																	
60"			60.0	75.0	60.0	75.0																			
(1) LONG DIMENSION	54"	60"	66"	72"	77"	84"	90"	96"	99"	102"	108"	120"	132"												

TABLE NOTES:
(1) ALL WINDOW DIMENSION VALUES SHOWN ARE +/-1/2" & ARE FRAME (F.H. & F.W.) DIMENSIONS

1/2" GLASSLAM SAFETY PLUS II LAMINATED ANNEALED GLASS (WITH GLAZING DETAIL 1 & GLAZING OPTION 1)																						
(1) SHORT DIMENSION	DESIGN LOAD CAPACITY (PSF)																					
	POS.	NEG	POS.	NEG	POS.	NEG	POS.	NEG	POS.	NEG	POS.	NEG	POS.	NEG	POS.	NEG	POS.	NEG	POS.	NEG	POS.	NEG
30"	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0
36"	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0
42"	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	67.3	67.3	65.0	65.0	61.5	61.5	60.5	60.5	57.1	57.1
48"	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	66.7	66.7	60.3	60.3	58.3	58.3	54.5	54.5	52.5	52.5	49.0	49.0
54"			70.0	70.0	70.0	70.0	70.0	70.0	69.0	69.0	61.7	61.7	55.0	55.0	52.8	52.8	49.6	49.6	48.2	48.2		
60"					70.0	70.0	70.0	70.0	63.2	63.2	57.9	57.9	51.6	51.6	50.3	50.3						
66"							63.6	65.5	58.9	58.9	53.3	53.3										
72"							58.3	61.6	55.3	55.3												
(1) LONG DIMENSION	48"		56"		64"		72"		80"		88"		96"		98"		104"		108"		120"	

DRAWN BY: W.W.S.		CHECKED BY: W.W.S.	
PLOT: 1-2		DATE: 06/06/01	
NO.	REVISION	DESCRIPTION	DATE
DIRECT SET 'CONTEMPRA' TFT ALUMINUM CLAD WOOD WINDOW MANUFACTURER WEATHER SHIELD WINDOWS & DOORS ONE WEATHER SHIELD PLAZA MEDFORD, WI 54451 715-748-6555			
CONSULTANTS W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. (CA 6809) 7480 150TH COURT NORTH PALM BEACH GARDENS, FL 33418 PHONE: 561-744-3424			
CERTIFICATION JUN 25 2014 WARREN W. SCHAEFER, P.E. P.E. NO. 44135			
DRAWING NO. 1054		REV. C	
SHEET NO. 4 OF 4			

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 14-0424.17
Expiration Date April 15, 2018
By *Manuel Perez*
Miami Dade Product Control